
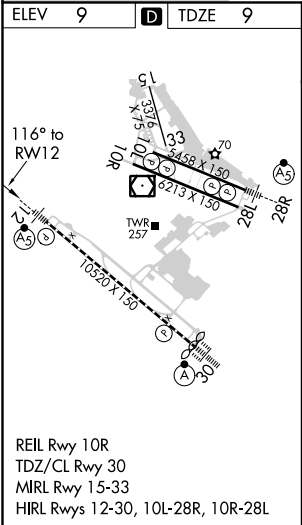
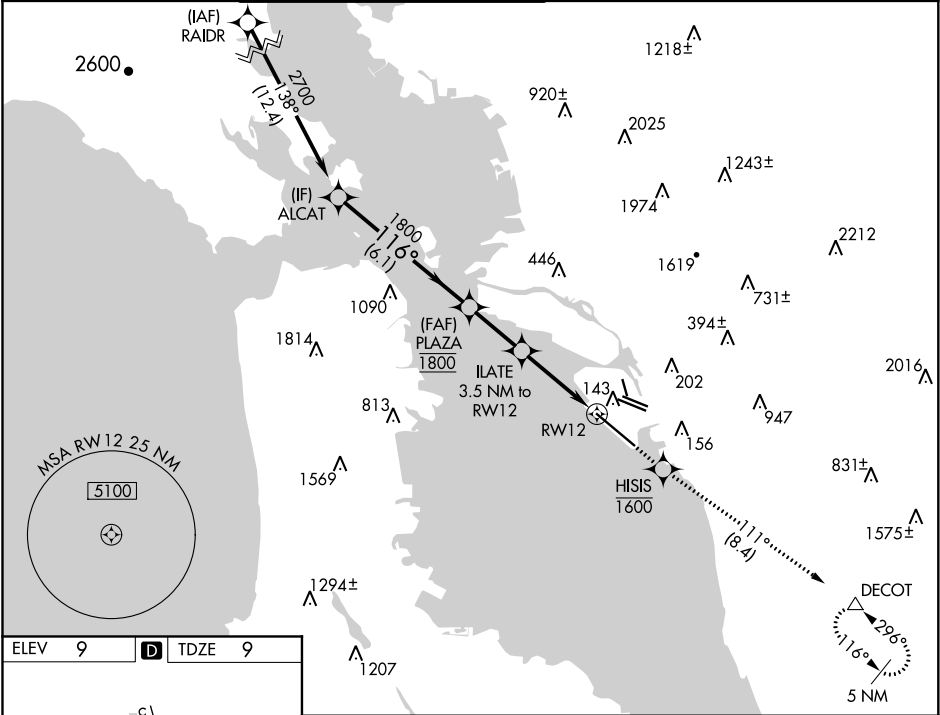


WAAS CH <b>86418</b> <b>W12A</b>	APP CRS <b>116°</b>	Rwy Idg <b>10000</b> TDZE <b>9</b> Apt Elev <b>9</b>
--	------------------------	--

**RNAV (GPS) Y RWY 12**  
METROPOLITAN OAKLAND INTL (OAK)

<div><div>▼</div><div>▲</div></div>	For uncompensated Baro-VNAV systems, LNAV/VNAV NA below 0°C (32°F) or above 54°C (130°F). DME/DME RNP-0.3 NA. #RVR 1800 authorized with use of FD or AP or HUD to DA.		<div>MALSR</div> <div></div>	MISSED APPROACH: Climb direct HISIS to cross HISIS at or below 1600, then climb to 5400 on track 111° to DECAT and hold, continue climb-in-hold to 5400.		
D-ATIS 133.775	NORCAL APP CON 125.35 263.15	OAKLAND TOWER 118.3 291.65 (Rwys 10L/R-28L/R, 15-33) 127.2 256.9 (Rwy 12-30)	GND CON 121.9 (Rwys 10L/R-28L/R, 15-33) 121.75 (Rwy 12-30)		CLNC DEL 121.1	CPDLC



VGSI and RNAV glidepath not coincident (VGSI Angle 2.75/TCH 70).			
ALCAT			
PLAZA			
ILATE			
HISIS			
DECAT			
GP 2.75° TCH 55			
CATEGORY			
LPV DA#			
LNAV/VNAV DA			
LNAV MDA			
CIRCLING			