WAAS CH 45502 W15A	APP CRS 150°	Rwy ldg 10702 TDZE 16 Apt Elev 17

RNAV (GPS) RWY 15
CHENNAULT INTL (CWF)

RNP APCH.

ASR

Baro-VNAV and VDP NA when using Lake Charles Rgnl altimeter setting. For uncompensated Baro-VNAV systems, procedure NA below -15°C or above 43°C. When local altimeter setting not received, use Lake Charles Rgnl altimeter setting and increase all DA 16 feet and all MDAs DA 20 feet, increase LNAV Cats C/D visibility 1/8 SM. For inop ALS, increase LNAV/VNAV all Cats visibility to 1 3/8 SM. For inop ALS when using Lake Charles Rgnl altimeter setting increase LNAV/VNAV visibility all Cats to 1 3/8 SM.

MALSR

MISSED APPROACH: Climb to 2000 direct FERDU and hold.

ATIS	LAKE CHARLES APP CON★	CHENNAULT TOWER★	GND CON	UNICOM
120.0	119.8 282.3	124.2 (CTAF) L 290.4	121.65 275.8	122.95

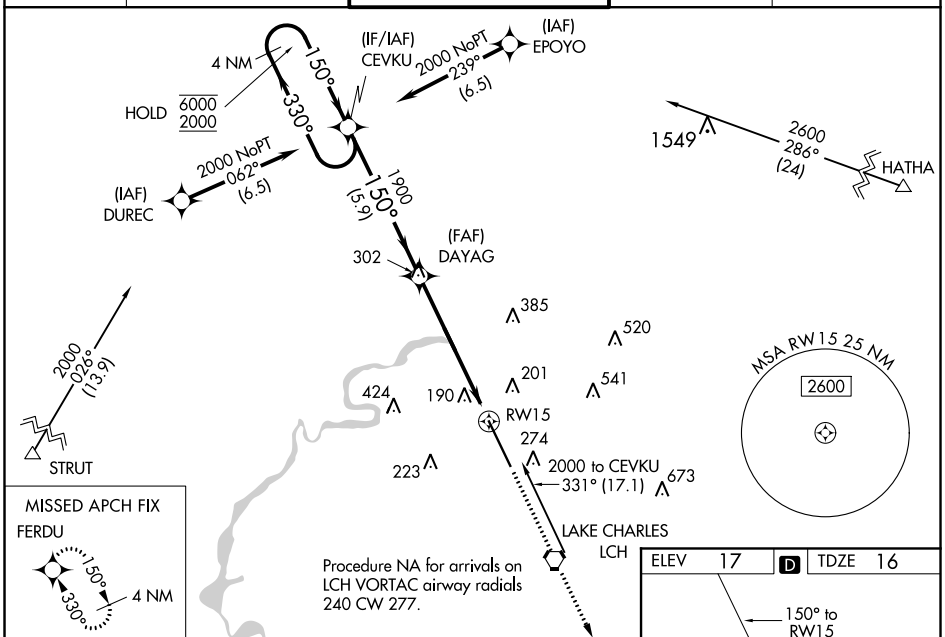

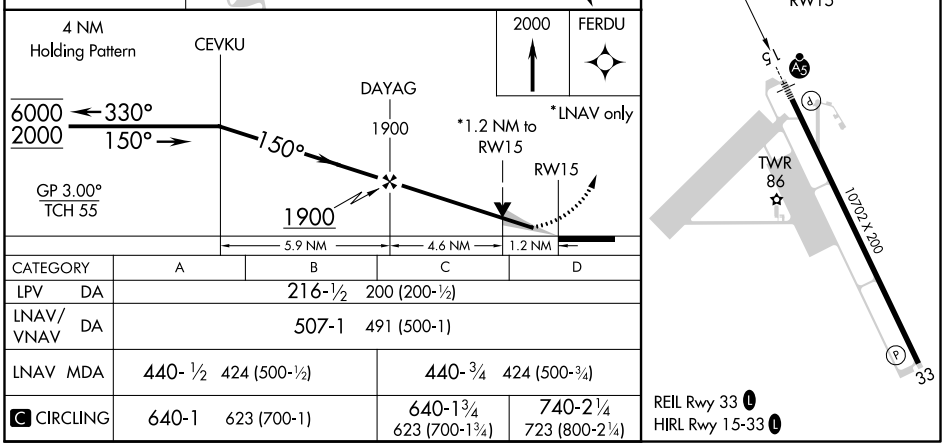

CATEGORY	A	B	C	D
LPV DA	216-½ 200 (200-½)			
LNAV/VNAV DA	507-1 491 (500-1)			
LNAV MDA	440- ½ 424 (500-½)		440- ¾ 424 (500-¾)	
C CIRCLING	640-1 623 (700-1)		640-1¾ 623 (700-1¾)	740-2¼ 723 (800-2¼)

SC-4, 31 DEC 2020 to 28 JAN 2021
SC-4, 31 DEC 2020 to 28 JAN 2021